
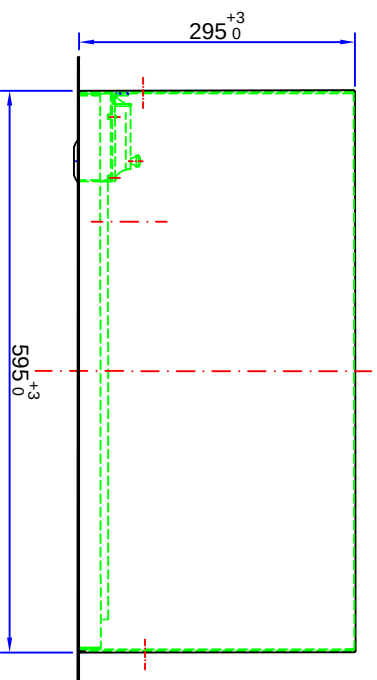


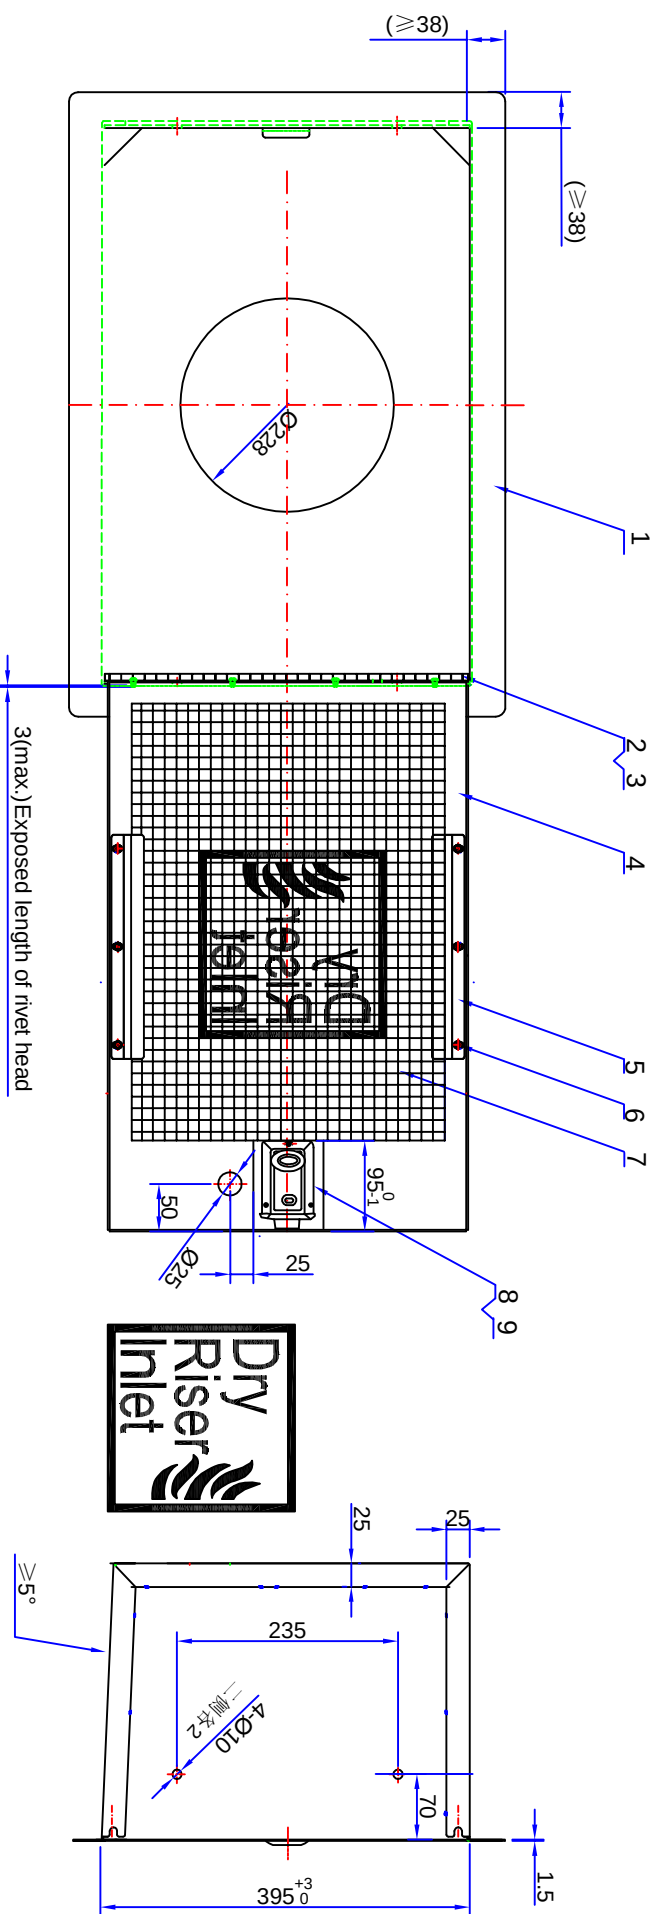

Technical Requirements:

1. Cabinet shell and door is connected with hinges and the door and hinges are connected through using d3.2 blind rivets(per picture shown);
2. When the cabinet is locked in close, the door shall be flush with cabinet; and the door opening angle shall be more than 180°;
3. When there is no key to open and in urgent use, just break the wire glass and directly open the latch lock by hand from inside.

No.	Drawing No.	Name	QTY	Material	Weight	Remark
10	DLX01-035-03-Y01	Marking	1			
9	GB/T818-2000	M4×16 Pan head screw	3	Steel		Galvanized
8	DLX02-037A	Latch lock	1	Assembly		
7	DLX01-042B-03	Wire glass	1	Glass 465×340×6mm		
6	GB/T6182-2000	M5 Hexagon locking nut	6	Copper		Nickel plating
5	DLX02-039A	Press plate	1	SUS304		
4	DLX01-042B-02	Door	1	SUS304		
3	GB12618-90	Blind rivet d 3.2	8	Aluminium		
2	DLX02-040	Hinge	1	SUS304		
1	DLX01-042B-01	Cabinet shell	1	SUS304		
Drawing No.			QTY	Material	Weight	Remark
395×595×295						
Fire Cabinet						
Code No.						
HC011						
Assembly						
W.T. ~14.5Kg						
Scale						
Hydrotech						
Zone						
Revision note						
Audit						
Date						
Signature						
Checked						
Approved						