
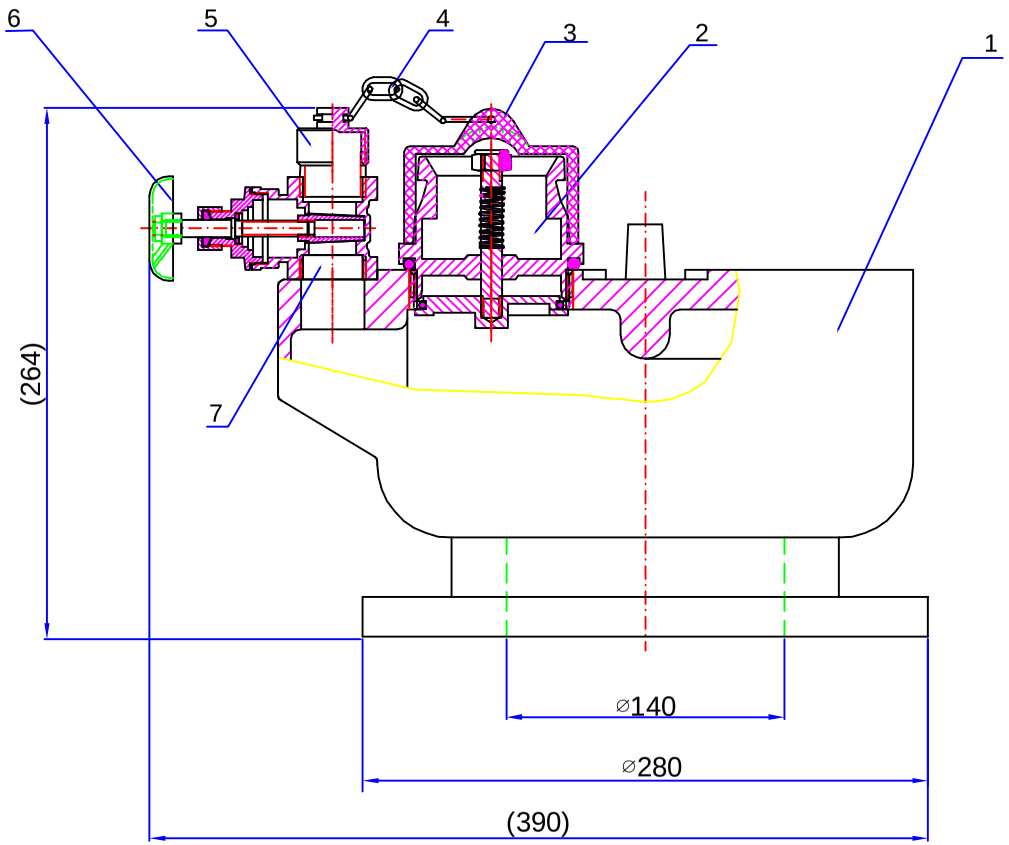


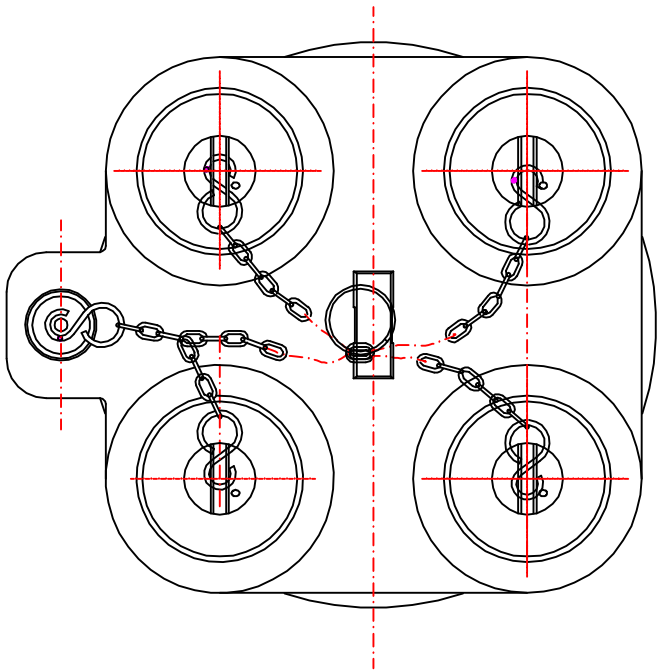

Technical Requirements:

1、When 1'' joint is connected to valve body and 1'' gate valve, it shall be sealed with thread sealant 5071;

2、 The size of inlet flange at the bottom is DN150 and per standard BS10D;

3、After it is tested under water pressure of 20Bar, no leakage, damage and eternal deformation shall be caused.

No.	Drawing No.	Name	Q'TY	Material	Weight	Remark
7	DLS01-064-06	1''Joint	2	Steel(Nickel Plating)		
6	DLV05-002-00	1''Gate valve	1	Assembly		
5	DLS01-064-05	Aluminium cap	1	6061		
4	DLS01-064-04	Chain	1	SUS 304		
3	DLS01-008A-08	Cap	4	Plastic		
2	DLS01-064B-02-00	Connecting seat	4	Assembly		
1	DLS01-065C-01	Valve body	1	Ductile iron		

Zone	Revision note	Date	Signature

Four way inlet breeching valve

Code No. HV016

Assembly

Drawn		Audit	
Checked		Approved	

W.T. ~34.46Kg | Scale

Hydrotech